



IES INDOOR REPORT

PHOTOMETRIC FILENAME : BX920LED4HTLOWT40120V-277V_S.IES

DESCRIPTION INFORMATION (From Photometric File)

IESNA:LM-63-2002

[TESTLAB] Photopia 2020.1.0 see: www.ltioptics.com/ies

[ISSUEDATE]

[TESTDATE] Fri May 28 10:58:09 2021

[TEST] 1

[MANUFAC]

[LUMCAT]

[LUMINAIRE] BX920LED4HTLOWT40120V-277V_S

[LAMP] LED 0.72W LUXEON 3030 2D Line (120mA)

[LAMPCAT] L130-3580003000X21

[OTHER]

CHARACTERISTICS

Lumens Per Lamp	N.A. (absolute)
Total Lamp Lumens	N.A. (absolute)
Luminaire Lumens	7317
Total Luminaire Efficiency	N.A.
Luminaire Efficacy Rating (LER)	146
Total Luminaire Watts	50
Ballast Factor	1.00
CIE Type	Direct
Spacing Criterion (0-180)	1.32
Spacing Criterion (90-270)	1.32
Spacing Criterion (Diagonal)	1.42
Basic Luminous Shape	Rectangular w/Sides
Luminous Length (0-180)	4.31 ft
Luminous Width (90-270)	0.55 ft
Luminous Height	0.29 ft

LUMINANCE DATA (cd/sq.m)

Angle In Degrees	Average 0-Deg	Average 45-Deg	Average 90-Deg
45	10752	8102	7542
55	9778	6721	6142
65	8111	4903	4380
75	5263	2578	2234
85	1386	426	352

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BX920LED4HTLOWT40120V-277V_S.IES

CANDELA TABULATION

	<u>0</u>
0.0	2544.39
2.5	2576.12
5.0	2561.00
7.5	2517.25
10.0	2509.44
12.5	2496.24
15.0	2493.15
17.5	2478.30
20.0	2440.43
22.5	2408.21
25.0	2357.04
27.5	2307.25
30.0	2260.05
32.5	2192.27
35.0	2125.01
37.5	2060.19
40.0	1983.71
42.5	1894.98
45.0	1801.94
47.5	1707.83
50.0	1602.34
52.5	1489.19
55.0	1365.10
57.5	1240.69
60.0	1123.38
62.5	992.07
65.0	870.90
67.5	750.35
70.0	625.30
72.5	499.04
75.0	378.37
77.5	274.85
80.0	182.34
82.5	104.50
85.0	47.42
87.5	13.72
90.0	0.45
92.5	0.00
95.0	0.00
97.5	0.00
100.0	0.00
102.5	0.00
105.0	0.00
107.5	0.00
110.0	0.00
112.5	0.00
115.0	0.00
117.5	0.00
120.0	0.01
122.5	0.00
125.0	0.00
127.5	0.00
130.0	0.00
132.5	0.01

IES INDOOR REPORT

PHOTOMETRIC FILENAME : BX920LED4HTLOWT40120V-277V_S.IES

CANDELA TABULATION - (Cont.)

135.0	0.01
137.5	0.01
140.0	0.00
142.5	0.01
145.0	0.01
147.5	0.01
150.0	0.00
152.5	0.00
155.0	0.00
157.5	0.00
160.0	0.00
162.5	0.00
165.0	0.00
167.5	0.00
170.0	0.00
172.5	0.00
175.0	0.00
177.5	0.00
180.0	0.00

IES INDOOR REPORT
PHOTOMETRIC FILENAME : BX920LED4HTLOWT40120V-277V_S.IES

ZONAL LUMEN SUMMARY

Zone	Lumens	%Lamp	%Fixt
0-20	945.75	N.A.	12.90
0-30	2033.56	N.A.	27.80
0-40	3365.05	N.A.	46.00
0-60	5974.6	N.A.	81.70
0-80	7246.79	N.A.	99.00
0-90	7316.65	N.A.	100.00
10-90	7074.7	N.A.	96.70
20-40	2419.3	N.A.	33.10
20-50	3808.88	N.A.	52.10
40-70	3471.92	N.A.	47.50
60-80	1272.19	N.A.	17.40
70-80	409.82	N.A.	5.60
80-90	69.86	N.A.	1.00
90-110	0.06	N.A.	0.00
90-120	0.06	N.A.	0.00
90-130	0.06	N.A.	0.00
90-150	0.07	N.A.	0.00
90-180	0.07	N.A.	0.00
110-180	0.01	N.A.	0.00
0-180	7316.73	N.A.	100.00

Total Luminaire Efficiency = N.A. %

ZONAL LUMEN SUMMARY

Zone	Lumens
0-10	241.95
10-20	703.80
20-30	1087.8
30-40	1331.5
40-50	1389.57
50-60	1219.97
60-70	862.37
70-80	409.82
80-90	69.86
90-100	0.06
100-110	0.00
110-120	0.00
120-130	0.00
130-140	0.01
140-150	0.00
150-160	0.00
160-170	0.00
170-180	0.00

IES INDOOR REPORT
 PHOTOMETRIC FILENAME : BX920LED4HTLOWT40120V-277V_S.IES

COEFFICIENTS OF UTILIZATION - ZONAL CAVITY METHOD

Effective Floor Cavity Reflectance 0.20

RC	80				70				50			30			10			0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	109	105	101	97	107	103	99	95	98	95	92	94	92	90	91	89	87	85
2	100	92	85	79	97	90	84	78	86	81	77	83	79	75	80	76	73	71
3	91	81	73	66	88	79	72	66	76	70	64	73	68	63	71	66	62	60
4	83	71	63	56	81	70	62	56	68	61	55	65	59	54	63	58	53	51
5	76	64	55	48	74	63	54	48	61	53	47	59	52	47	57	51	46	44
6	71	57	48	42	69	56	48	42	55	47	42	53	46	41	51	45	41	39
7	65	52	43	37	64	51	43	37	50	42	37	48	41	36	47	41	36	34
8	61	47	39	33	59	47	39	33	45	38	33	44	37	33	43	37	32	30
9	57	43	35	30	55	43	35	30	42	35	29	41	34	29	40	34	29	27
10	53	40	32	27	52	40	32	27	39	32	27	38	31	27	37	31	26	25


IES INDOOR REPORT
PHOTOMETRIC FILENAME : BX920LED4HTLOWT40120V-277V_S.IES

UGR TABLE - CORRECTED

Reflectances											
Ceiling Cavity	70	70	50	50	30	70	70	50	50	30	
Walls	50	30	50	30	30	50	30	50	30	30	
Floor Cavity	20	20	20	20	20	20	20	20	20	20	
Room Size		UGR Viewed Crosswise					UGR Viewed Endwise				
X=2H	Y=2H	19.3	20.9	19.7	21.3	21.6	19.3	20.9	19.7	21.3	21.6
	3H	20.8	22.3	21.2	22.6	22.9	20.8	22.3	21.2	22.6	22.9
	4H	21.2	22.6	21.6	22.9	23.3	21.2	22.6	21.6	22.9	23.3
	6H	21.4	22.7	21.8	23.1	23.4	21.4	22.7	21.8	23.1	23.4
	8H	21.5	22.7	21.9	23.1	23.4	21.5	22.7	21.9	23.1	23.4
	12H	21.5	22.6	21.9	23.0	23.4	21.5	22.6	21.9	23.0	23.4
4H	2H	19.7	21.1	20.1	21.4	21.8	19.7	21.1	20.1	21.4	21.8
	3H	21.3	22.5	21.7	22.9	23.3	21.3	22.5	21.7	22.9	23.3
	4H	21.8	22.8	22.2	23.2	23.7	21.8	22.8	22.2	23.2	23.7
	6H	22.1	23.0	22.5	23.4	23.9	22.1	23.0	22.5	23.4	23.9
	8H	22.1	23.0	22.6	23.4	23.9	22.1	23.0	22.6	23.4	23.9
	12H	22.1	22.9	22.6	23.4	23.8	22.1	22.9	22.6	23.4	23.8
8H	4H	21.9	22.7	22.4	23.2	23.6	21.9	22.7	22.4	23.2	23.6
	6H	22.2	22.9	22.7	23.4	23.8	22.2	22.9	22.7	23.4	23.8
	8H	22.2	22.9	22.7	23.4	23.9	22.2	22.9	22.7	23.4	23.9
	12H	22.3	22.8	22.8	23.3	23.9	22.3	22.8	22.8	23.3	23.9
12H	4H	21.9	22.6	22.4	23.1	23.6	21.9	22.6	22.4	23.1	23.6
	6H	22.2	22.8	22.7	23.3	23.8	22.2	22.8	22.7	23.3	23.8
	8H	22.3	22.8	22.8	23.3	23.8	22.3	22.8	22.8	23.3	23.8

Maximum UGR = 23.9

POLAR GRAPH

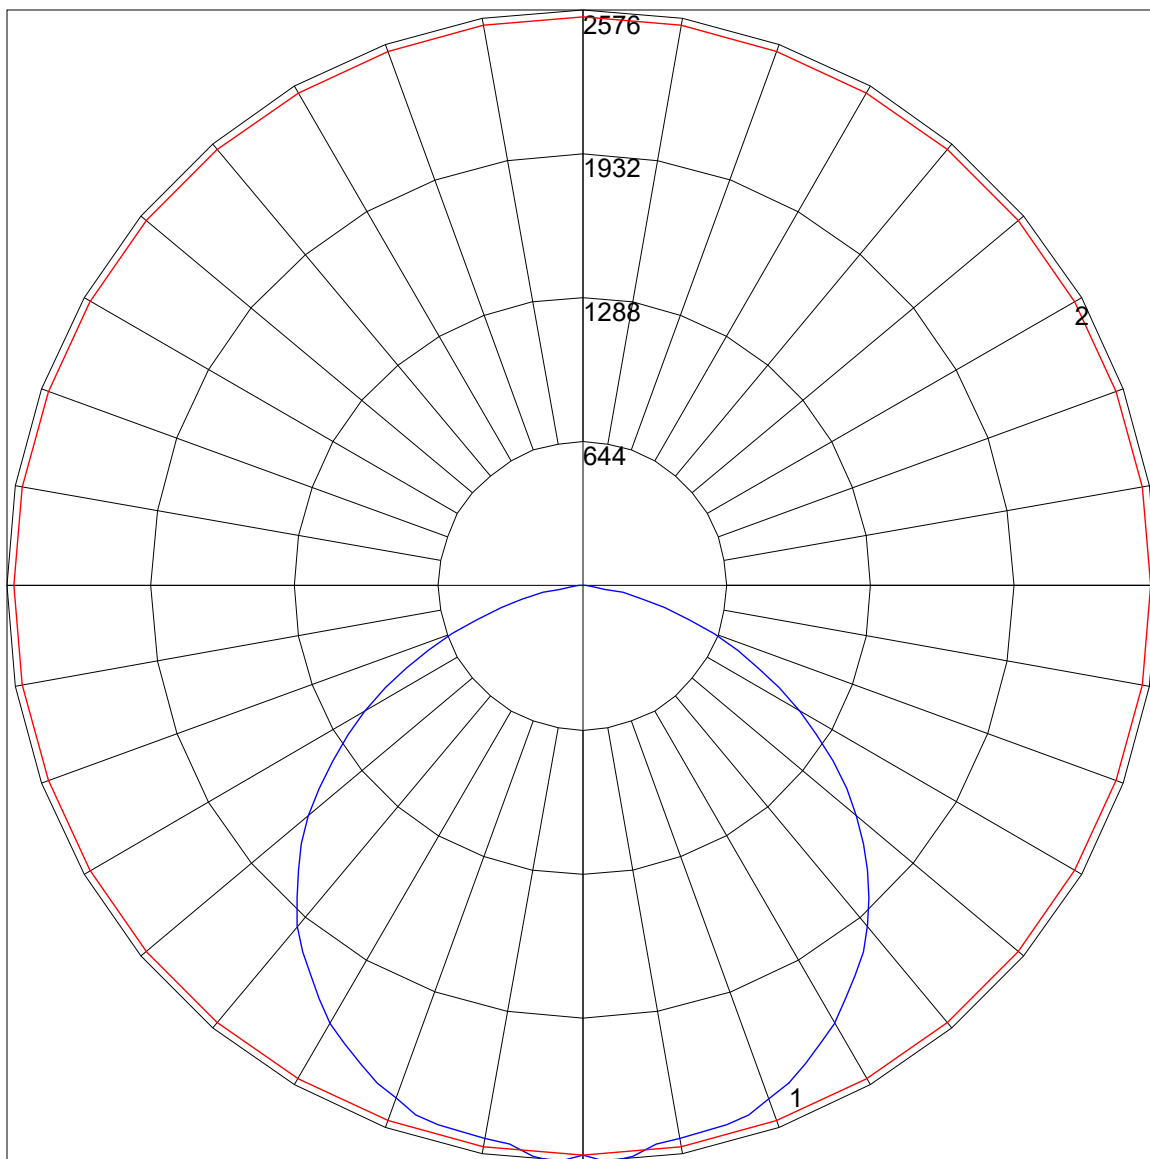

Maximum Candela = 2576.12 Located At Horizontal Angle = 0, Vertical Angle = 2.5
1 - Vertical Plane Through Horizontal Angles (0 - 180) (Through Max. Cd.)
2 - Horizontal Cone Through Vertical Angle (0)